

TEST REPORT



E-mail: info@janoshik.com

Web: www.janoshik.com

Task Number #162843

Testing ordered > 12 MAY '26

Sample received > 15 MAY '26

Client drakonpeptides.com

Sample DSIP 10mg

Manufacturer Unknown

Batch DRK-DSI-MAY26

Sample description >

See picture or pictures attached.

Tests requested >

DSIP analysis

Results >



DSIP	10.50 mg
Purity	99.301%

Comments >

Analysis conducted > 22 MAY 2026

Signature >

A handwritten signature in black ink, appearing to be 'Janoshik' or similar, written over a light blue background.

Verify this test at www.janoshik.com/verify/ with the following unique key

M3R89QKXLQ2N





Analysis Report


<Sample Information>

Sample Name : 21424-1 DSIP 10mg
 Sample ID : 066
 Data Filename : 21424-1 DSIP 10mg_042.lcd
 Method Filename : 251007_ACN-H2O_Peptidy2_0.5.lcm
 Batch Filename : 2026020_1.lcb
 Vial # : 3-6
 Injection Volume : 0.5 uL
 Date Acquired : 20.05.2026 21:18:23
 Date Processed : 20.05.2026 21:24:31

Sample Type : Unknown
 Acquired by : System Administrator
 Processed by : System Administrator

<Chromatogram>

mAU

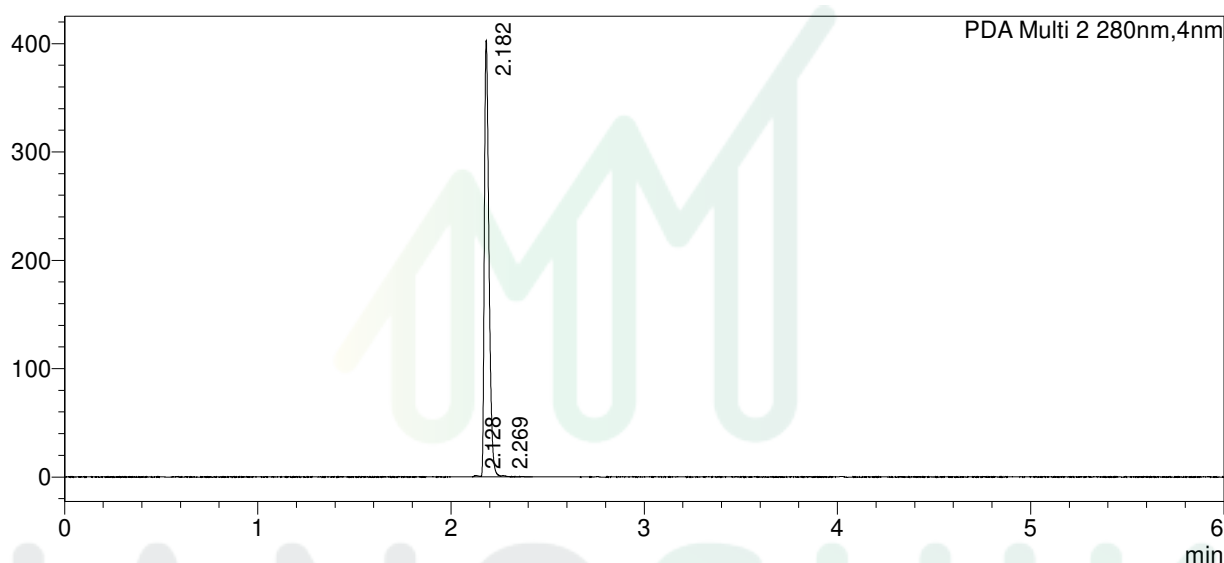

<Peak Table>

PDA Ch2 280nm

Peak#	Ret. Time	Area	Conc.	Unit	Name	Area%
1	2.128	1820	0.00			0.274
2	2.182	659177	10.50	mg	DSIP	99.301
3	2.269	2819	0.00			0.425
Total		663815				100.000

TEST REPORT



E-mail: info@janoshik.com

Web: www.janoshik.com

Task Number #162845

Testing ordered > 12 MAY '26

Sample received > 15 MAY '26

Client drakonpeptides.com

Sample DSIP 10mg

Manufacturer Unknown

Batch DRK-DSI-MAY26

Sample description >

See picture or pictures attached.

Tests requested >

Heavy Metals Analysis

Results >



As	not detected.
Cd	not detected.
Pb	not detected.

Comments >

Hg: not detected. Although the raw data show low ppm values for heavy metals, these do not necessarily indicate true detection. As shown in the attached graphs, the signals are consistent with electronic noise inherent to the detection system; therefore, the results were concluded as "not detected".

Analysis conducted > 20 MAY 2026

Signature >

A handwritten signature in black ink, appearing to be 'Janoshik' or similar, written over a light blue background.

Verify this test at www.janoshik.com/verify/ with the following unique key

8PS1N2FLUETW




Sample : 21424-1
 Operator: MB
 Comment : Comment
 Group : As_test
 Date : 2026-05-20 11:04:06

Measurement Condition

Instrument	Atmosphere	Collimator	Sample Cup
EDX-7000	Air	10 (mm)	Polypropylene

Analyte	TG kV	uA	FI	Acq. (keV)	Anal. (keV)	Time (sec)	DT (%)
As	Rh 50	26-Auto	----	0 - 40	10.30-10.80	Live- 54	29

[cps/uA]

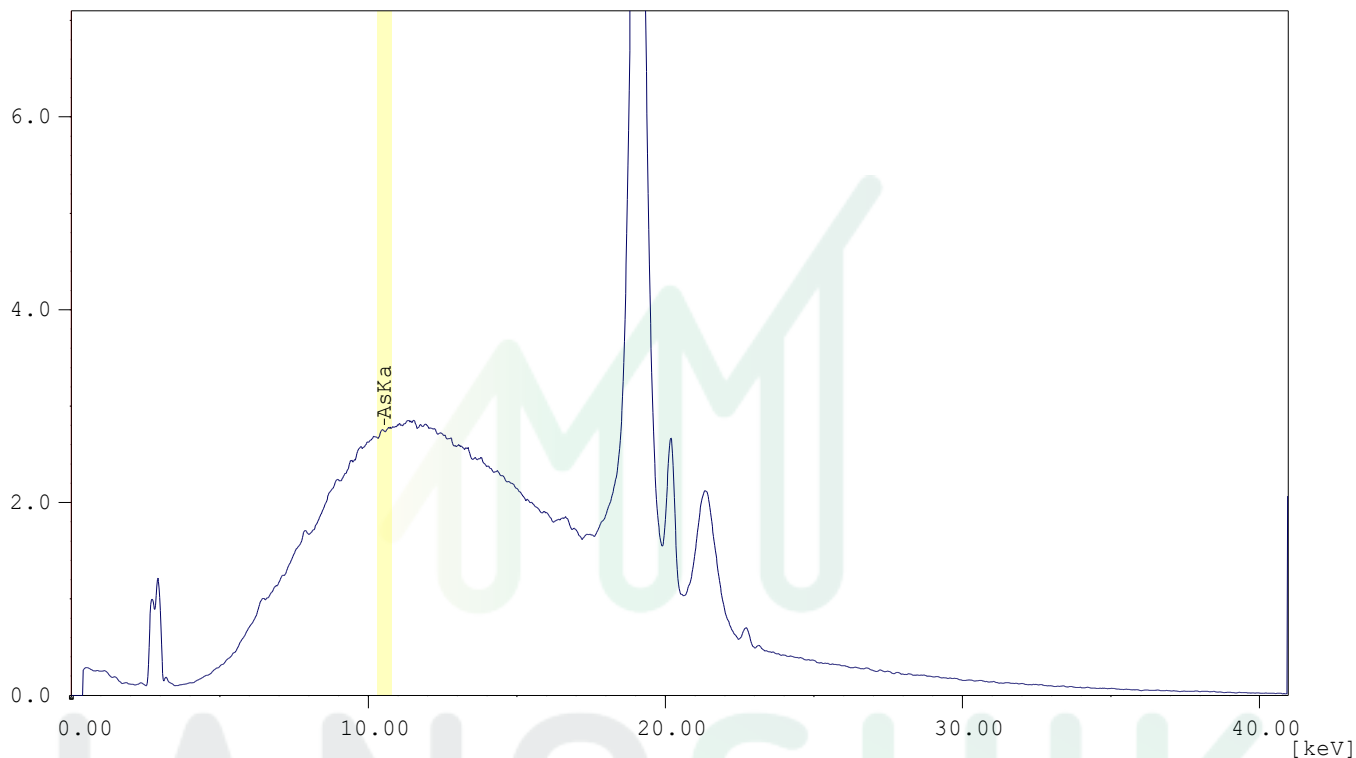

Peak List

Channel	Line	keV	Net Int. (cps/uA)
As	AsKa	10.54	0.4175

Quantitative Result

Analyte	Result	[3-sigma]	Proc.-Calc.	Line	Int. (cps/uA)
As	1.8 ppm	L [2.9]	Quan-EC	AsKa	0.4175

Sample : 21424-1
 Operator: MB
 Comment : Comment
 Group : Hg_Pb_Cd
 Date : 2026-05-20 10:41:45

Measurement Condition

Instrument: EDX-7000 Atmosphere: Air Collimator: 10(mm) Sample Cup: Polypropylene

Analyte	TG kV	uA	FI	Acq. (keV)	Anal. (keV)	Time(sec)	DT(%)
Cd	Rh 50	999-Auto	#5	0 - 40	22.72-23.52	Live- 51	28
Hg	Rh 50	999-Auto	#5	0 - 40	9.74-10.24	Live- 51	28
Pb	Rh 50	999-Auto	#5	0 - 40	12.38-12.88	Live- 51	28

Qualitative Result

Element: Cd, Hg, Pb

Peak List

Channel	Line	keV	Net Int. (cps/uA)
Cd	CdKa	23.12	0.0004 Q
Hg	HgLa	9.98	0.0004 Q
Pb	PbLb1	12.62	0.0000 Q

Quantitative Result

Analyte	Result	[3-sigma]	Proc.-Calc.	Line	Int. (cps/uA)
Cd	3.7 ppm	L [2.1]	Quan-EC	CdKa	0.0004
Hg	0.3 ppm	L [0.8]	Quan-EC	HgLa	0.0004
Pb	2.8 ppm	L [3.0]	Quan-EC	PbLb1	0.0000

JANOSHNIK


Sample : 21424-1
Operator: MB

Group : Hg_Pb_Cd
Comment : Comment


Date : 2026-05-20 11:45
01/01




[cps/uA] Cd

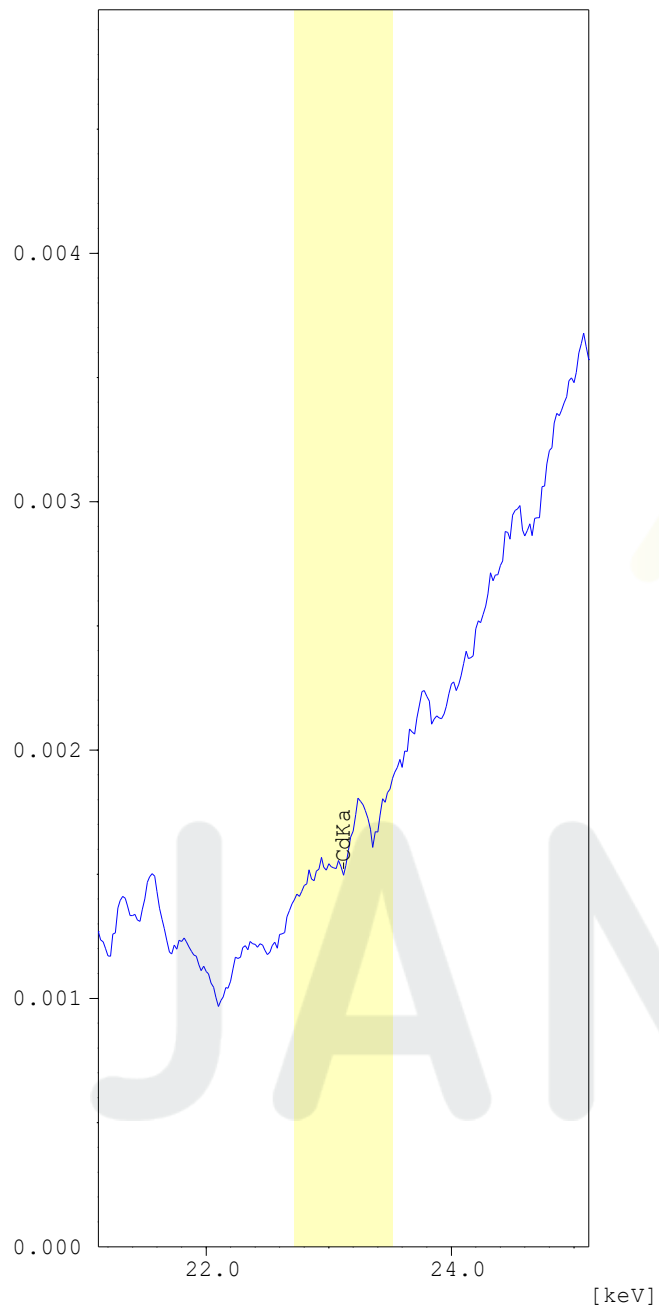

[cps/uA] Hg

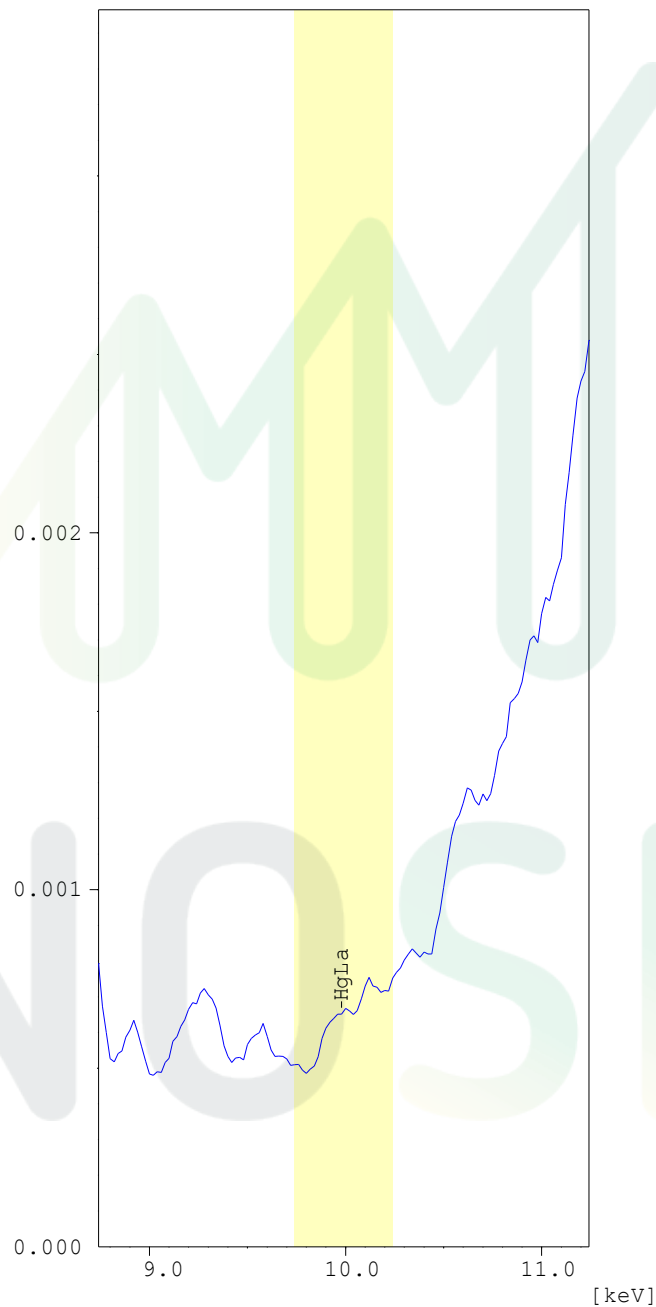

[cps/uA] Pb

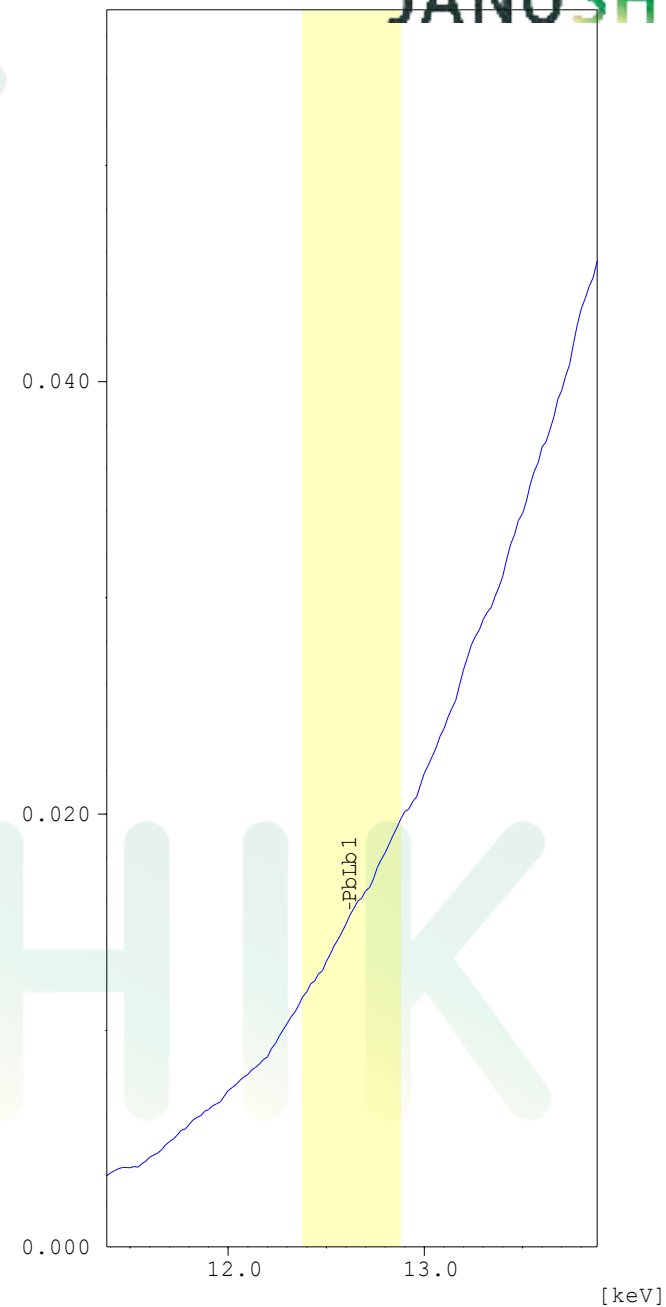

TEST REPORT



E-mail: info@janoshik.com

Web: www.janoshik.com

Task Number #162844

Testing ordered > 12 MAY '26

Sample received > 15 MAY '26

Client drakonpeptides.com

Sample DSIP 10mg

Manufacturer Unknown

Batch DRK-DSI-MAY26

Sample description >

See picture or pictures attached.

Tests requested >

LCMS Screening For Peptide Contamination

Results >



LCMS screening	

Comments >

LCMS analysis identified the presence of mannitol, DSIP, and degradation products. LCMS spectra are attached. No significant contamination detected.

Analysis conducted > 25 MAY 2026

Signature >

A handwritten signature in black ink, appearing to be 'Janoshik'.

Verify this test at www.janoshik.com/verify/ with the following unique key


E8TICL8MTMUZ



==== Shimadzu LabSolutions Data Report ====

<Spectrum>


Line#:1 R.Time:0.245(Scan#:115)
MassPeaks:85
RawMode:Single 0.245(115) BasePeak:205(7701872)
BG Mode:None Segment 1 - Event 1

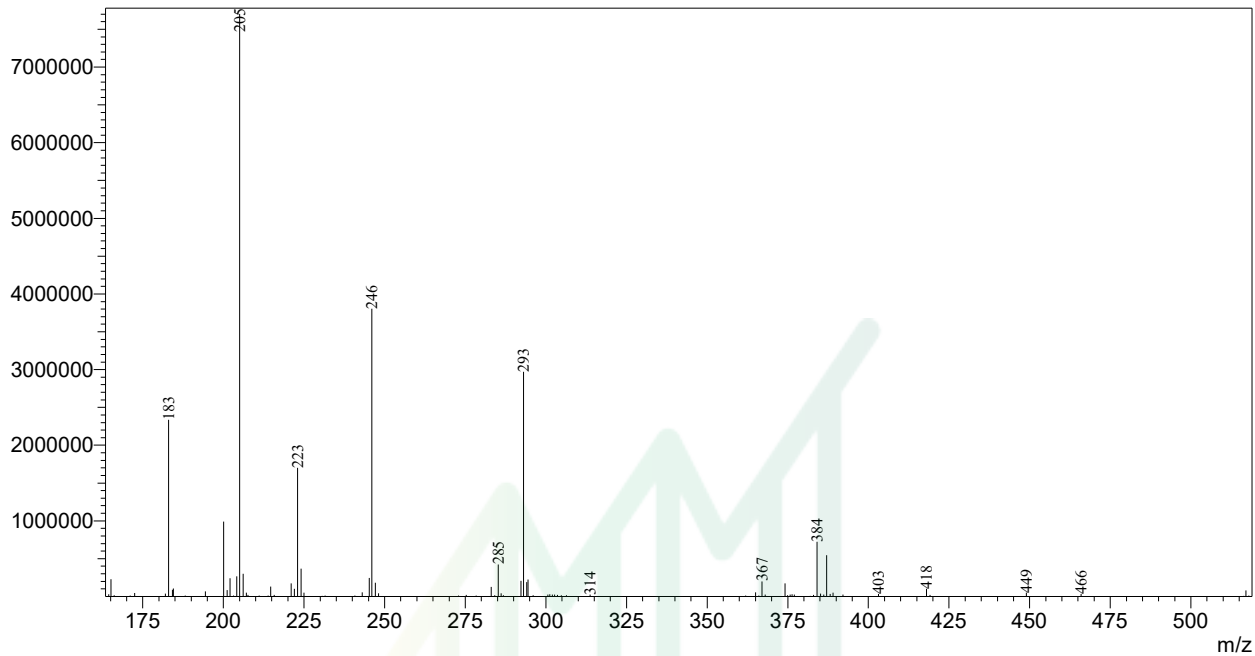

==== Shimadzu LabSolutions Data Report ====

<Spectrum>


Line#:1 R.Time:0.967(Scan#:451)
MassPeaks:107
RawMode:Single 0.967(451) BasePeak:849(10878973)
BG Mode:None Segment 1 - Event 1

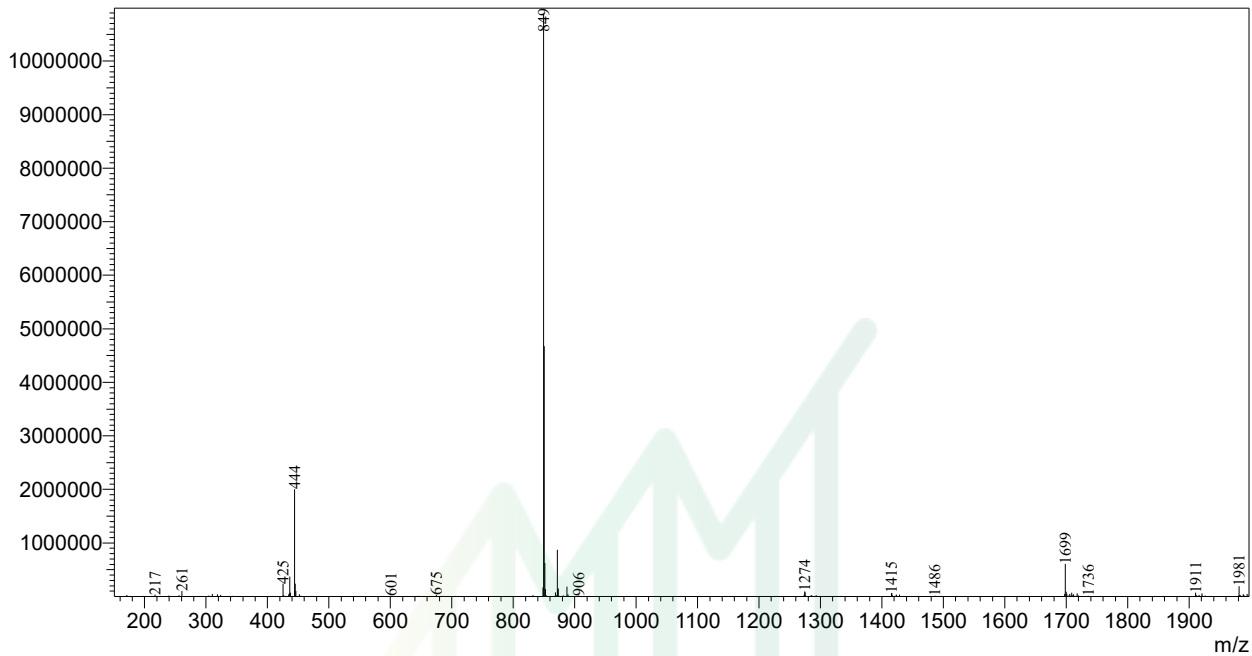

==== Shimadzu LabSolutions Data Report ====

<Spectrum>

Line#:1 R.Time:0.995(Scan#:464)
MassPeaks:73
RawMode:Single 0.995(464) BasePeak:849(2044547)
BG Mode:None Segment 1 - Event 1

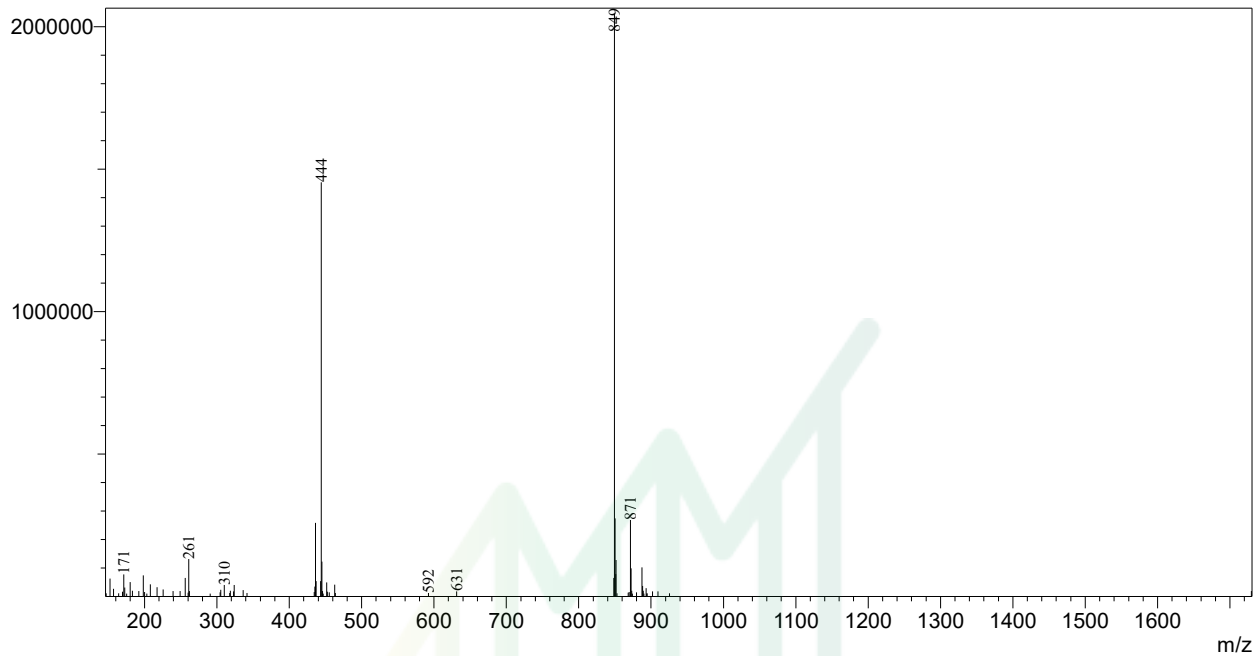

==== Shimadzu LabSolutions Data Report ====

<Chromatogram>

